


GENERAL ELECTRICAL TELECOMMUNICATIONS PLAN NOTES

- A. REFER TO DRAWING E-001 FOR ELECTRICAL LEGEND, GENERAL NOTES, AND ABBREVIATIONS.
- B. ALL CABLE TRAYS TO BE 24" WIDE UNLESS NOTED OTHERWISE.
- C. TELECOMMUNICATIONS TERMINATIONS SHALL BE MADE BY VA IRM (INFORMATION RESOURCES MANAGER)
- D. SEE DRAWING ET101 FOR ROUTING OF CABLE TRAY SYSTEM.
- E. PATCH PANEL SHALL BE ANGLED TYPE.
- F. THE UPS SYSTEM SHALL BE RACK MOUNTED.
- G. THE LOCATION OF THE UPS WITHIN THE RACK IS DIAGRAMMATIC ONLY, THE UPS SHALL BE MOUNTED IN BOTTOM OF IT RACK.

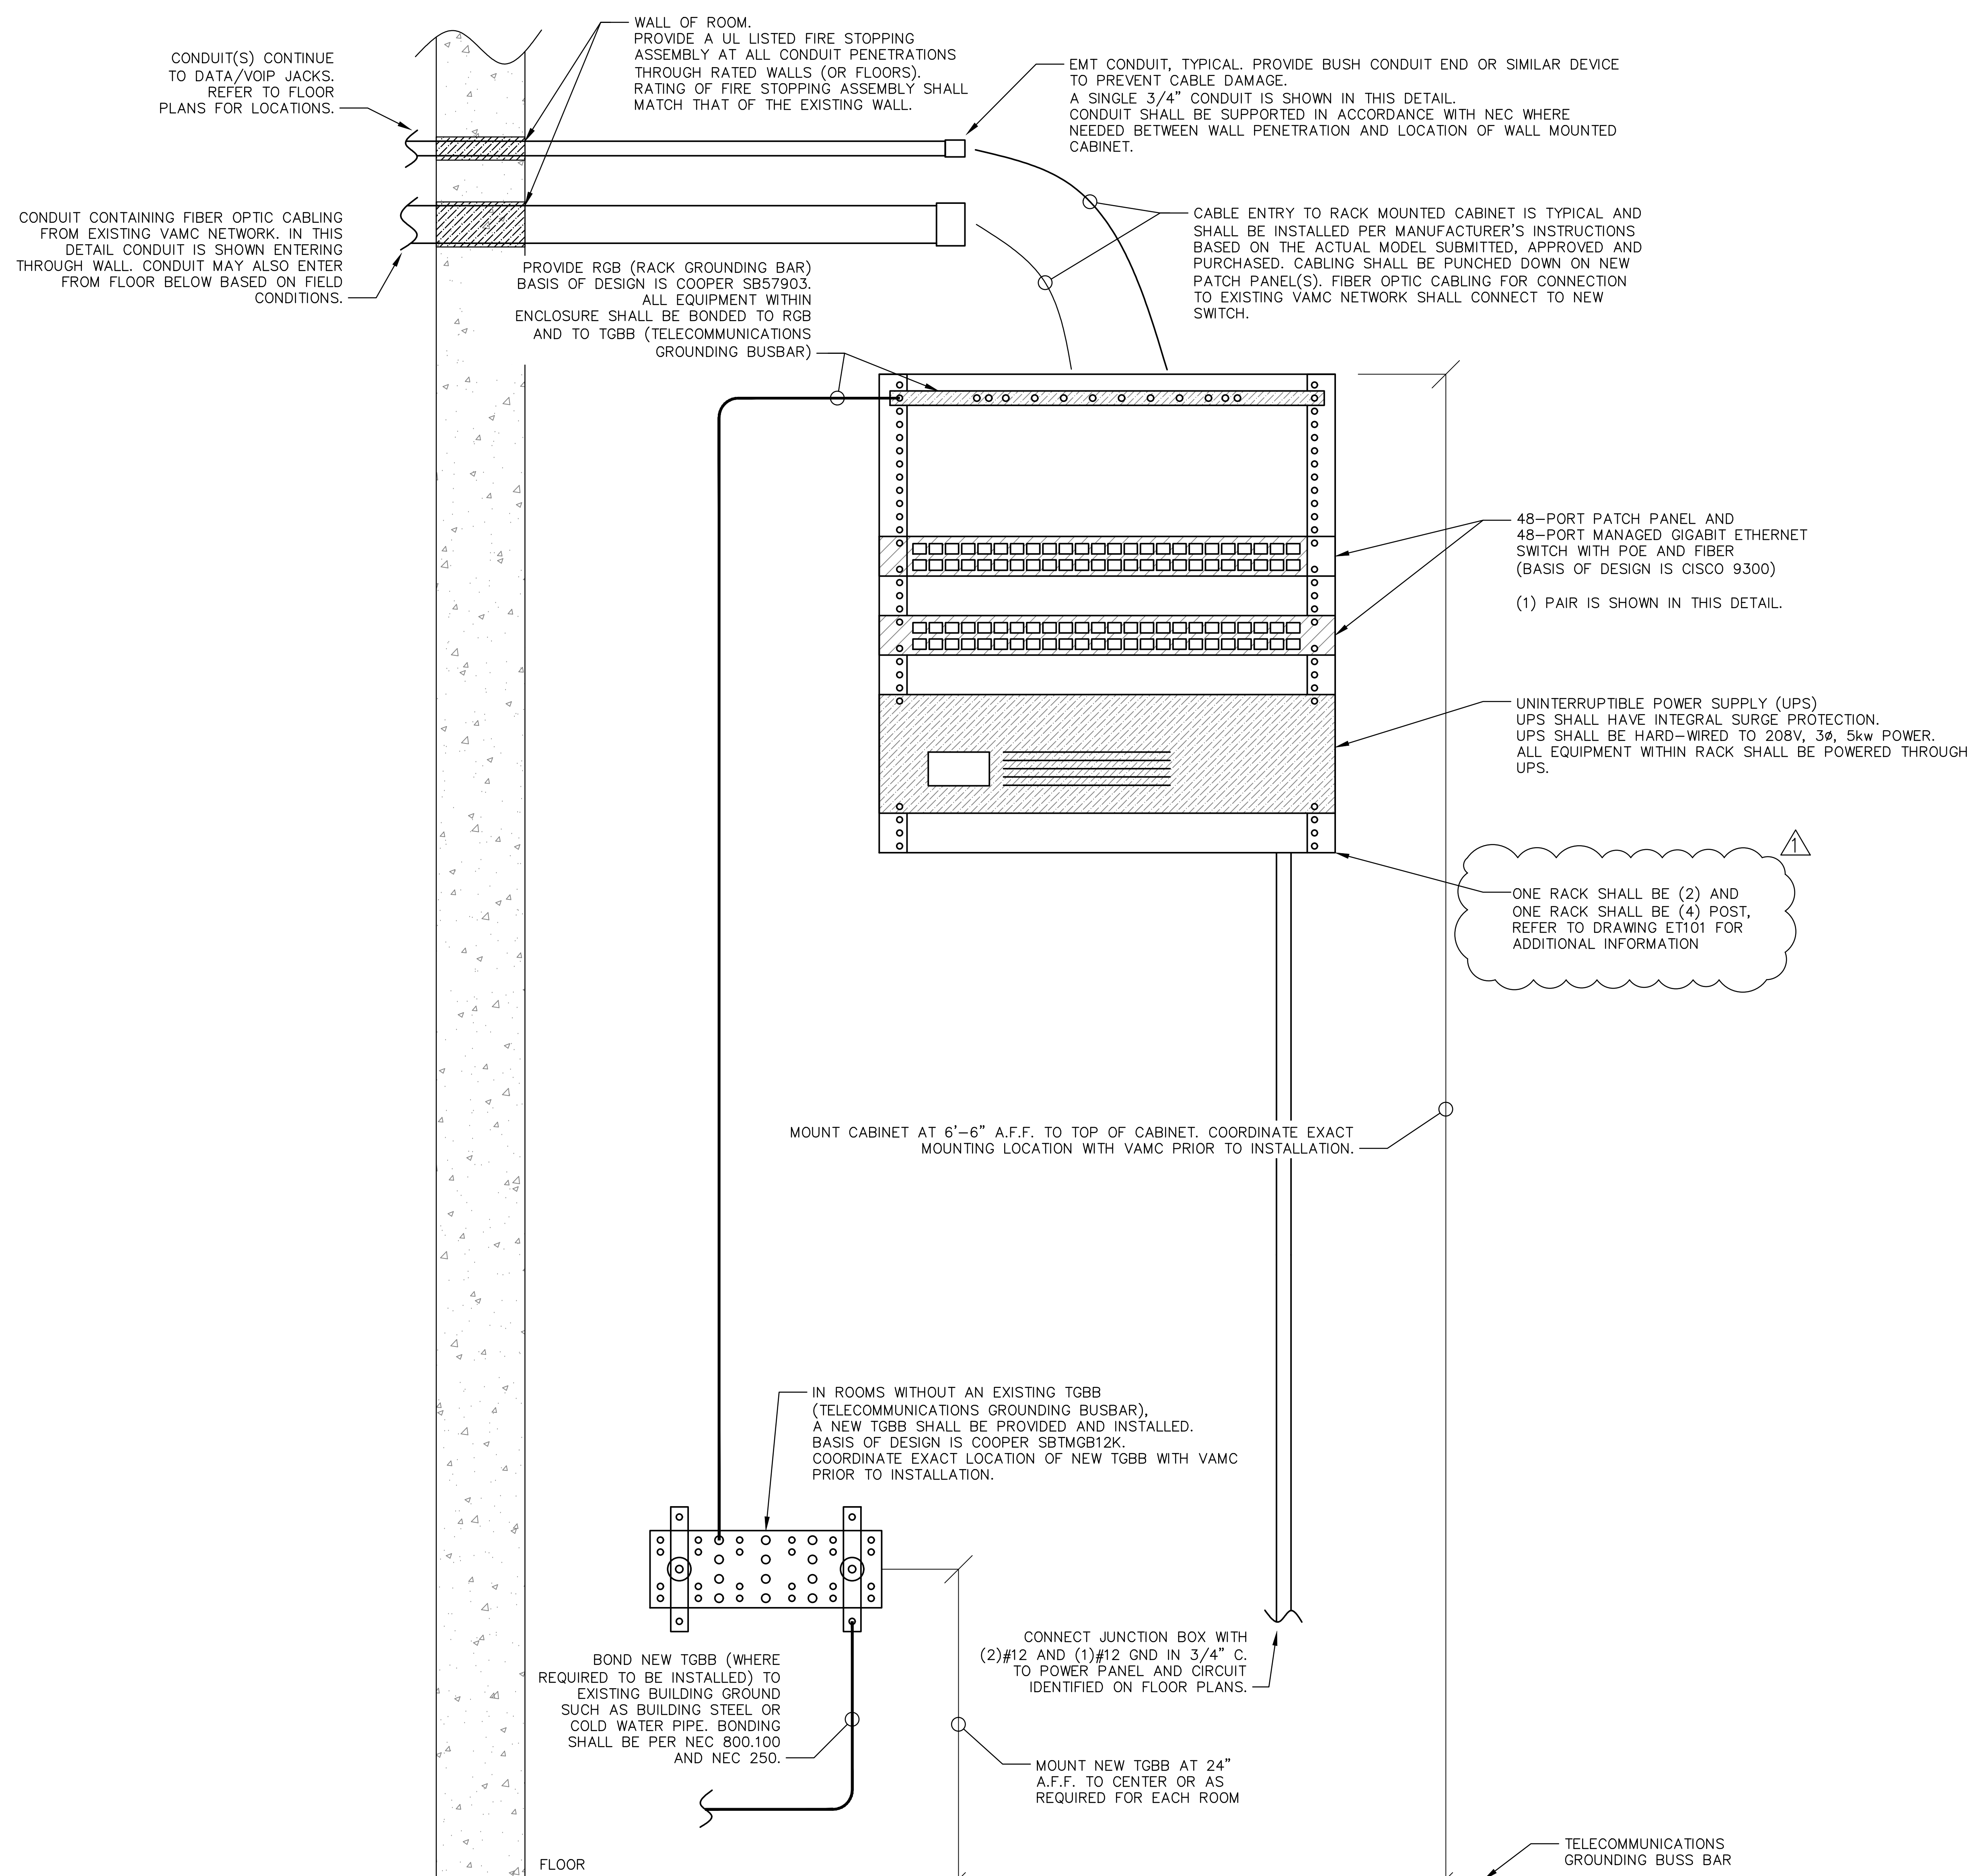

1 DIGITAL TELECOMMUNICATIONS WIRING DIAGRAM (TYPICAL OF IT CLOSET ROOM NO. 114)
NO SCALE

ADDENDUM 3 01-24-2025 Revisions: Date:	CONSULTANT	ARCHITECT/ENGINEER OF RECORD	STAMP	Office of Construction and Facilities Management	Drawing Title TELECOMMUNICATIONS DETAILS	Phase 100% CONSTRUCTION DOCUMENTS	Project Title SIOUX FALLS BOILER PLANT	Project Number 438-22-900
		 Architecture Engineering Design-Build 9000 Wellesley Place, Louisville, KY 40222 www.paradigmusa.com		U.S. Department of Veterans Affairs	Approved: Project Director	FULLY SPRINKLERED	Location VAMC-Sioux Falls: 2501 W 22nd St, Sioux Falls, SD 57105	Building Number 12
							Issue Date 06/25/2024	Drawing Number ET502