


Fire Damper to Remove	Fire Damper to Disable
BA-70-A	BB-96-A
BA-70-B	BC-20-A
BA-70-C	BC-20-B
BB-70-A	BC-20-C
BB-80A-A	BC-20-D
BB-80A-B	BB-96-A
BA-03-A	BB-80-A
BB-31-A	BB-80-B
BB-85-A DSBLD	BB-09-A
BB-85-B DSBLD	BB-09-B
BC-15-A DSBLD	BB-09-C
BC-15-B DSBLD	BA-01-D
BC-20B-A	BA-01-E
BB-80-D	BA-01-F
BC-67-A DSBLD	BA-01-G
BC-67-B DSBLD	BA-01-H
BC-91-A	
BC-93-A	
BC-63-A	
BC-68-A	
BC-90-A	
BC-90-A-A	
BC-90-B	
BC-90-C	
BC-94-A	
BC-90-A-A	
BC-90-B	
BC-90-C	
BC-94-B	
BE-29-F	
BE-29-E	
BE-29-G	
BE-29-D	
BE-29-C	
BE-29-A	
BE-29-B	
1D-16-A	
1D-16-B	
BE-25-C	
BE-25-B	
BE-25-A	


- LEGEND**
- 1 - HOUR FIRE RATED PARTITION
 - - - 2 - HOUR FIRE RATED PARTITION
 - - - - - SMOKE BARRIER
 - FIRE DAMPER - EXISTING
 - FIRE DAMPER - DISABLED
 - FIRE DAMPER - OUT OF SERVICE SYSTEM



FARGO VAHCS
2101 ELM STREET
FARGO, ND 58102

Drawing Title



Basement Floor
FIRE DAMPER
8/22/2024

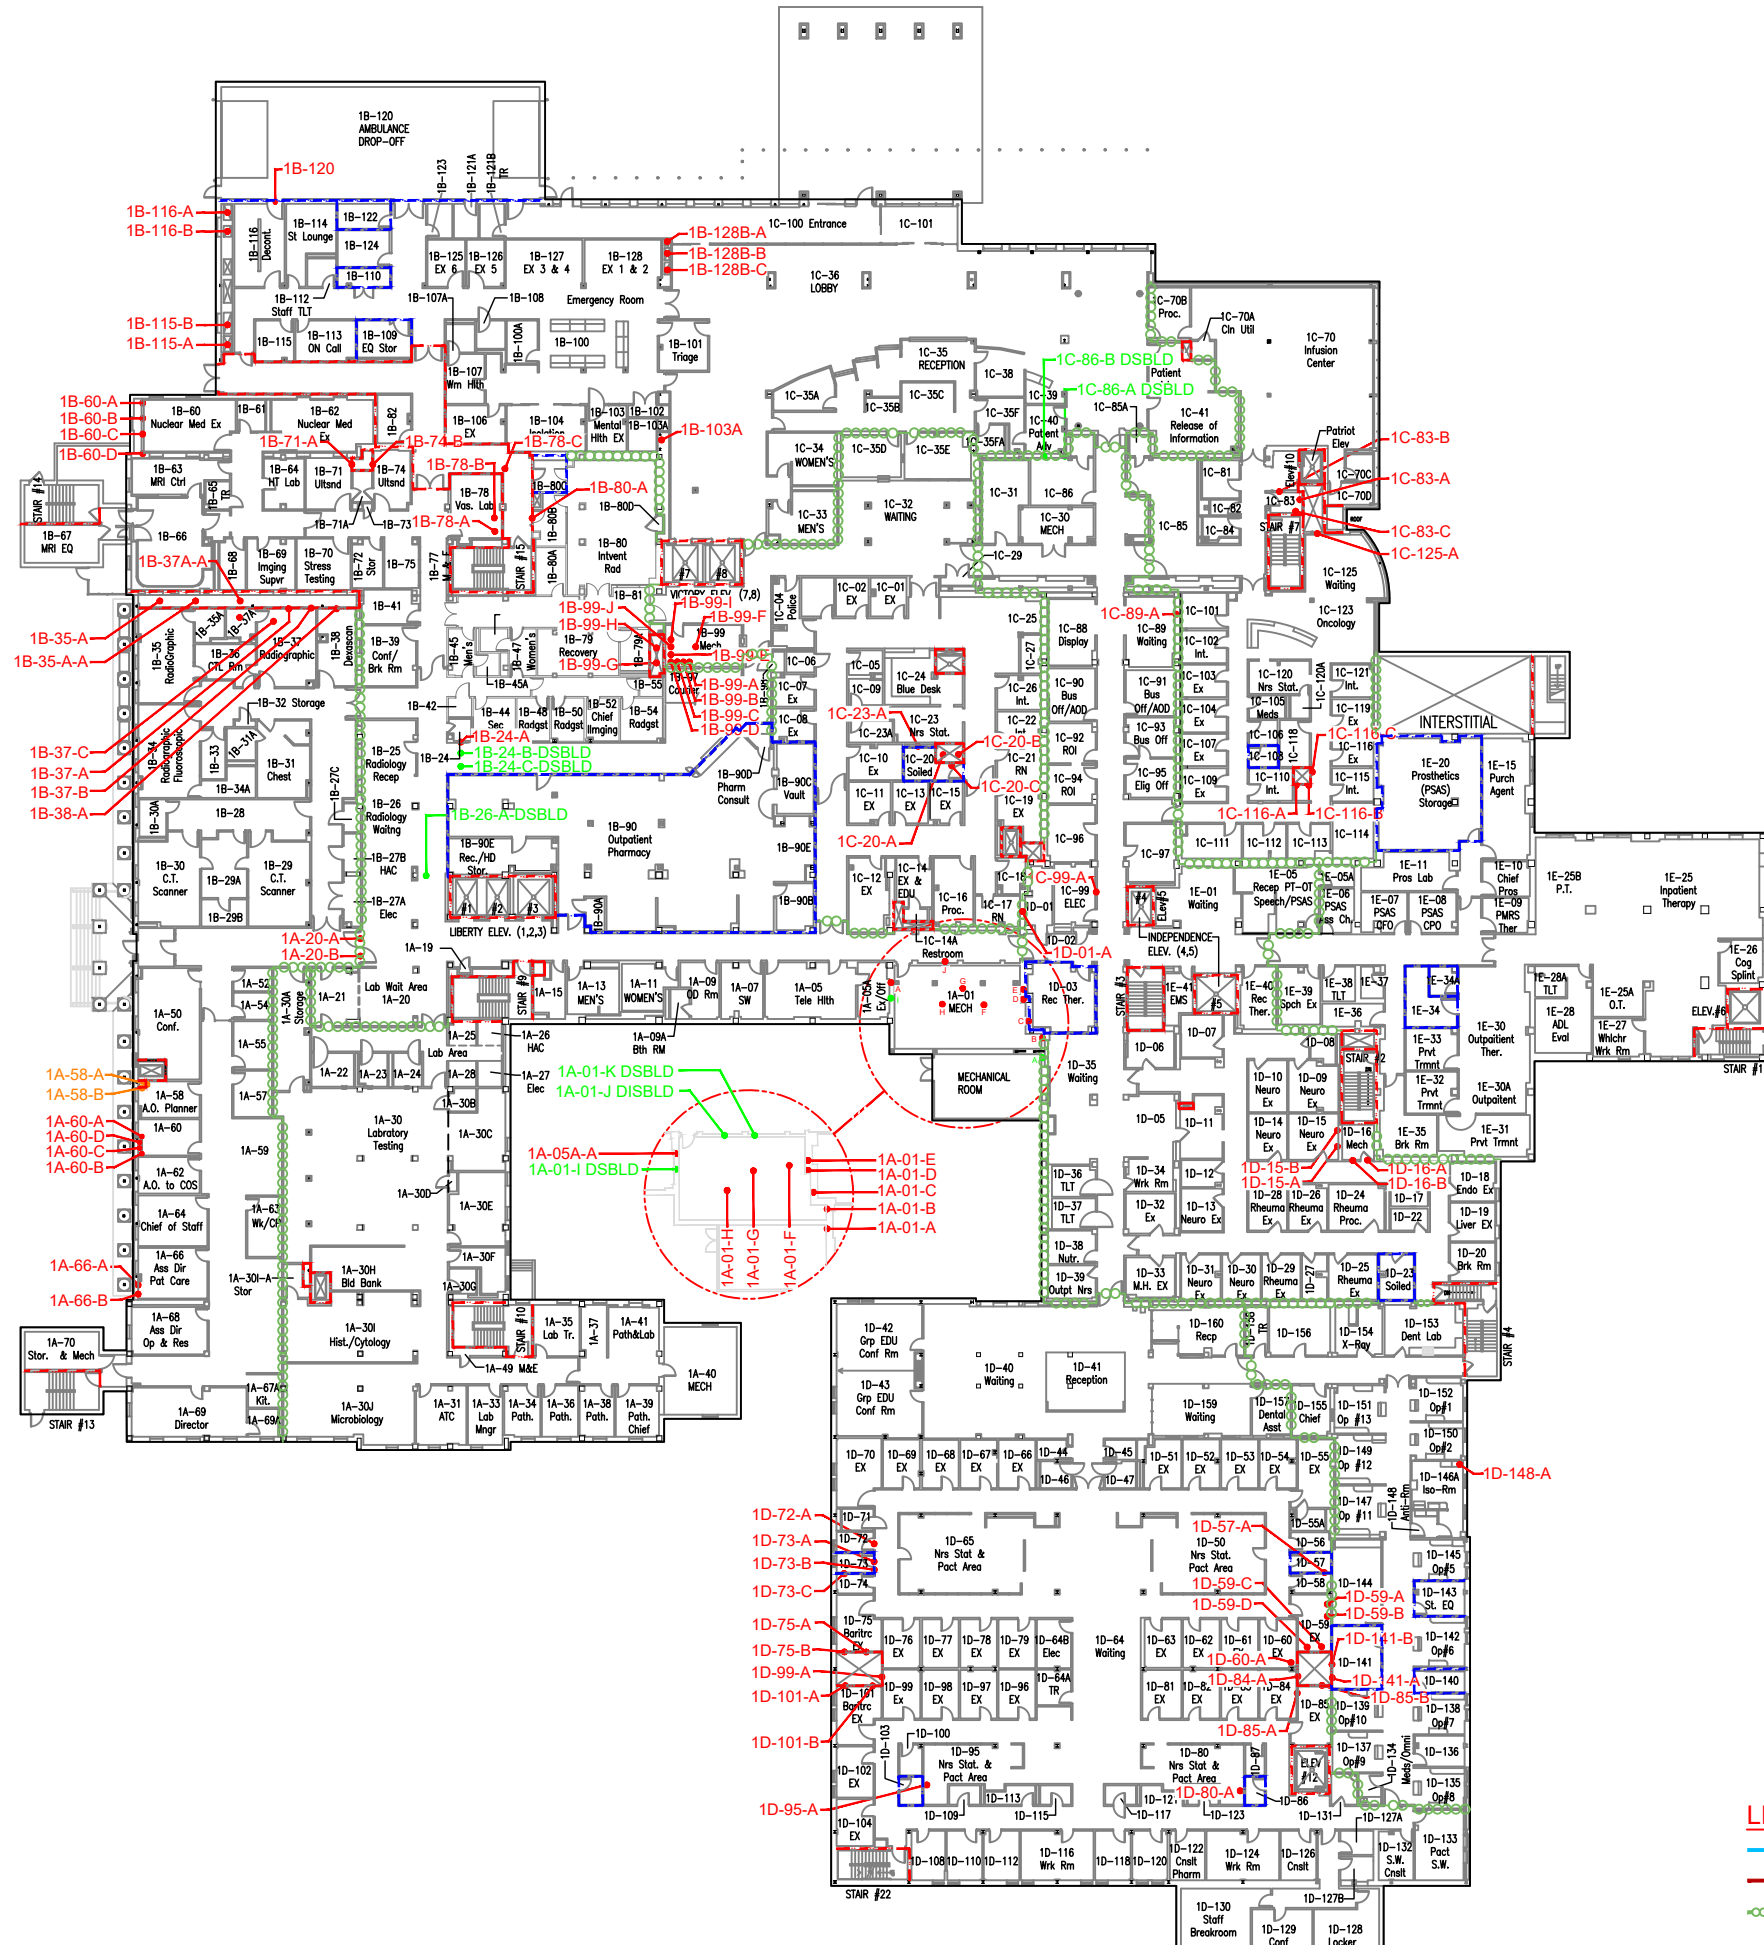

- LEGEND**
- 1 - HOUR FIRE RATED PARTITION
 - 2 - HOUR FIRE RATED PARTITION
 - SMOKE BARRIER
 - FIRE DAMPER - EXISTING
 - FIRE DAMPER - DISABLED
 - FIRE DAMPER - OUT OF SERVICE SYSTEM

FARGO VAHCS
 2101 ELM STREET
 FARGO, ND 58102

Drawing Title
**First Floor
 FIRE DAMPER**
 8/22/2024

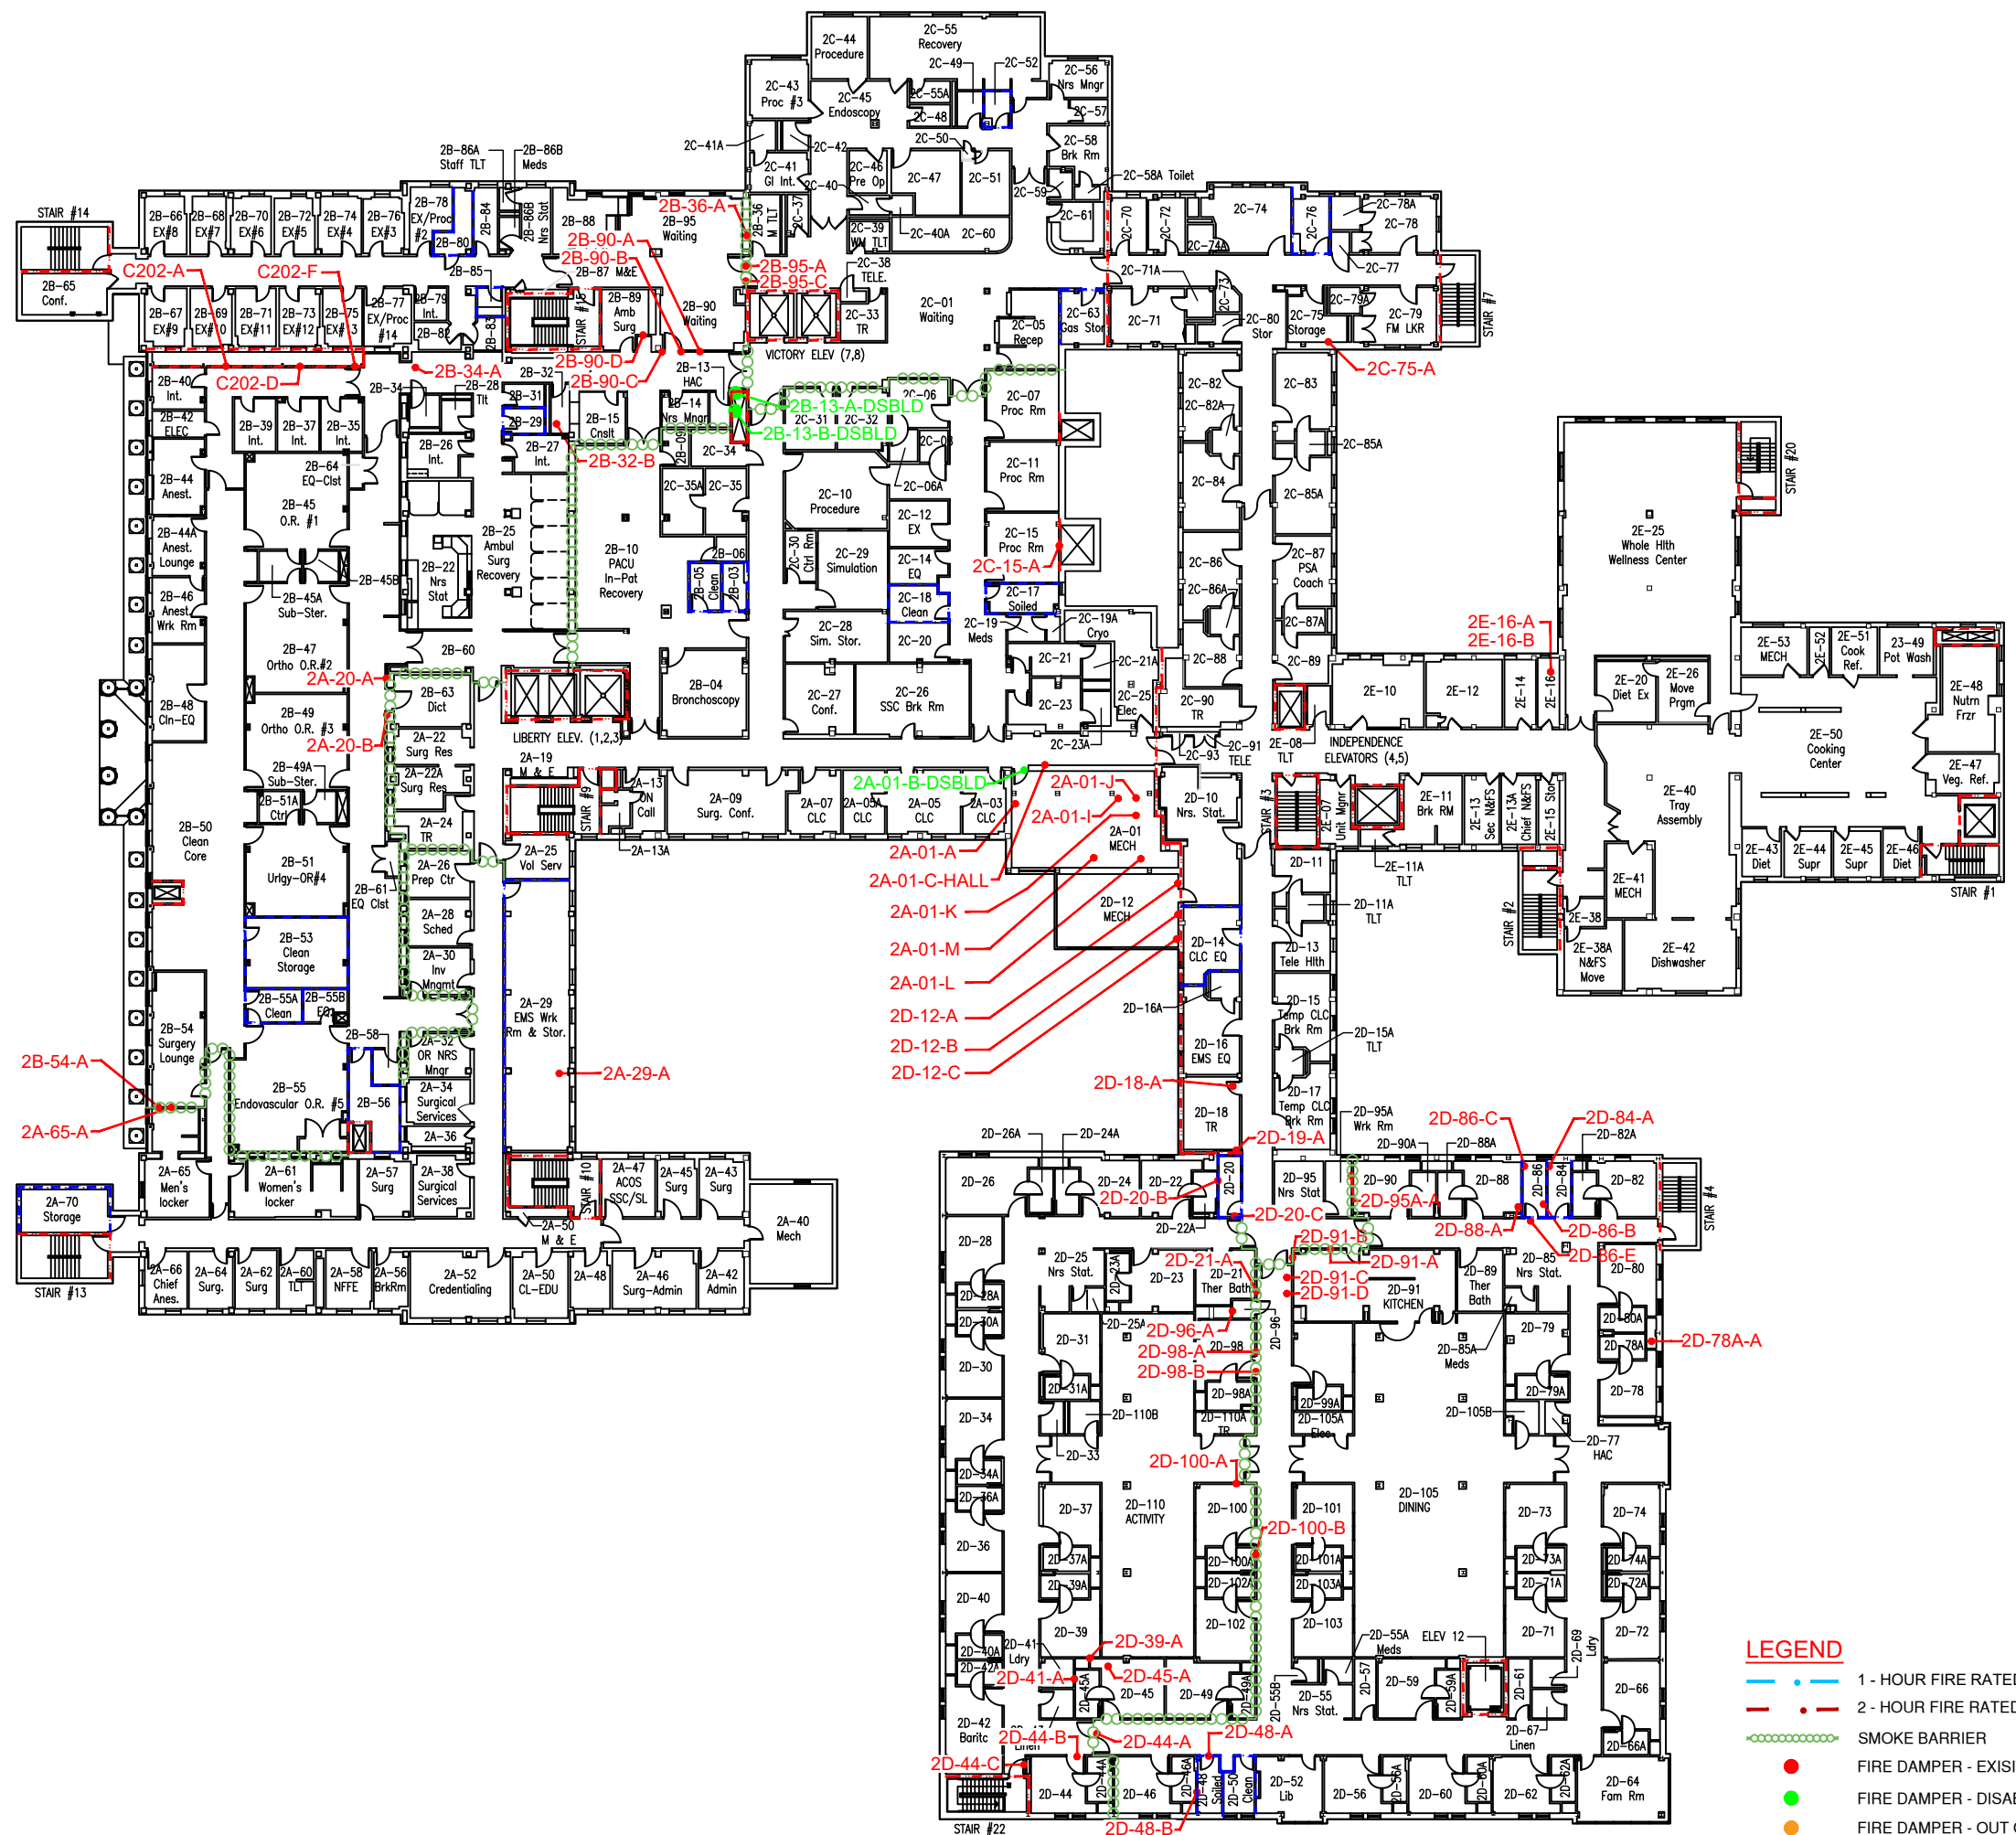


FARGO VAHCS
 2101 ELM STREET
 FARGO, ND 58102


Drawing Title

Second Floor
FIRE DAMPER
 8/22/2024

- LEGEND**
- 1 - HOUR FIRE RATED PARTITION
 - 2 - HOUR FIRE RATED PARTITION
 - - - SMOKE BARRIER
 - FIRE DAMPER - EXISTING
 - FIRE DAMPER - DISABLED
 - FIRE DAMPER - OUT OF SERVICE SYSTEM

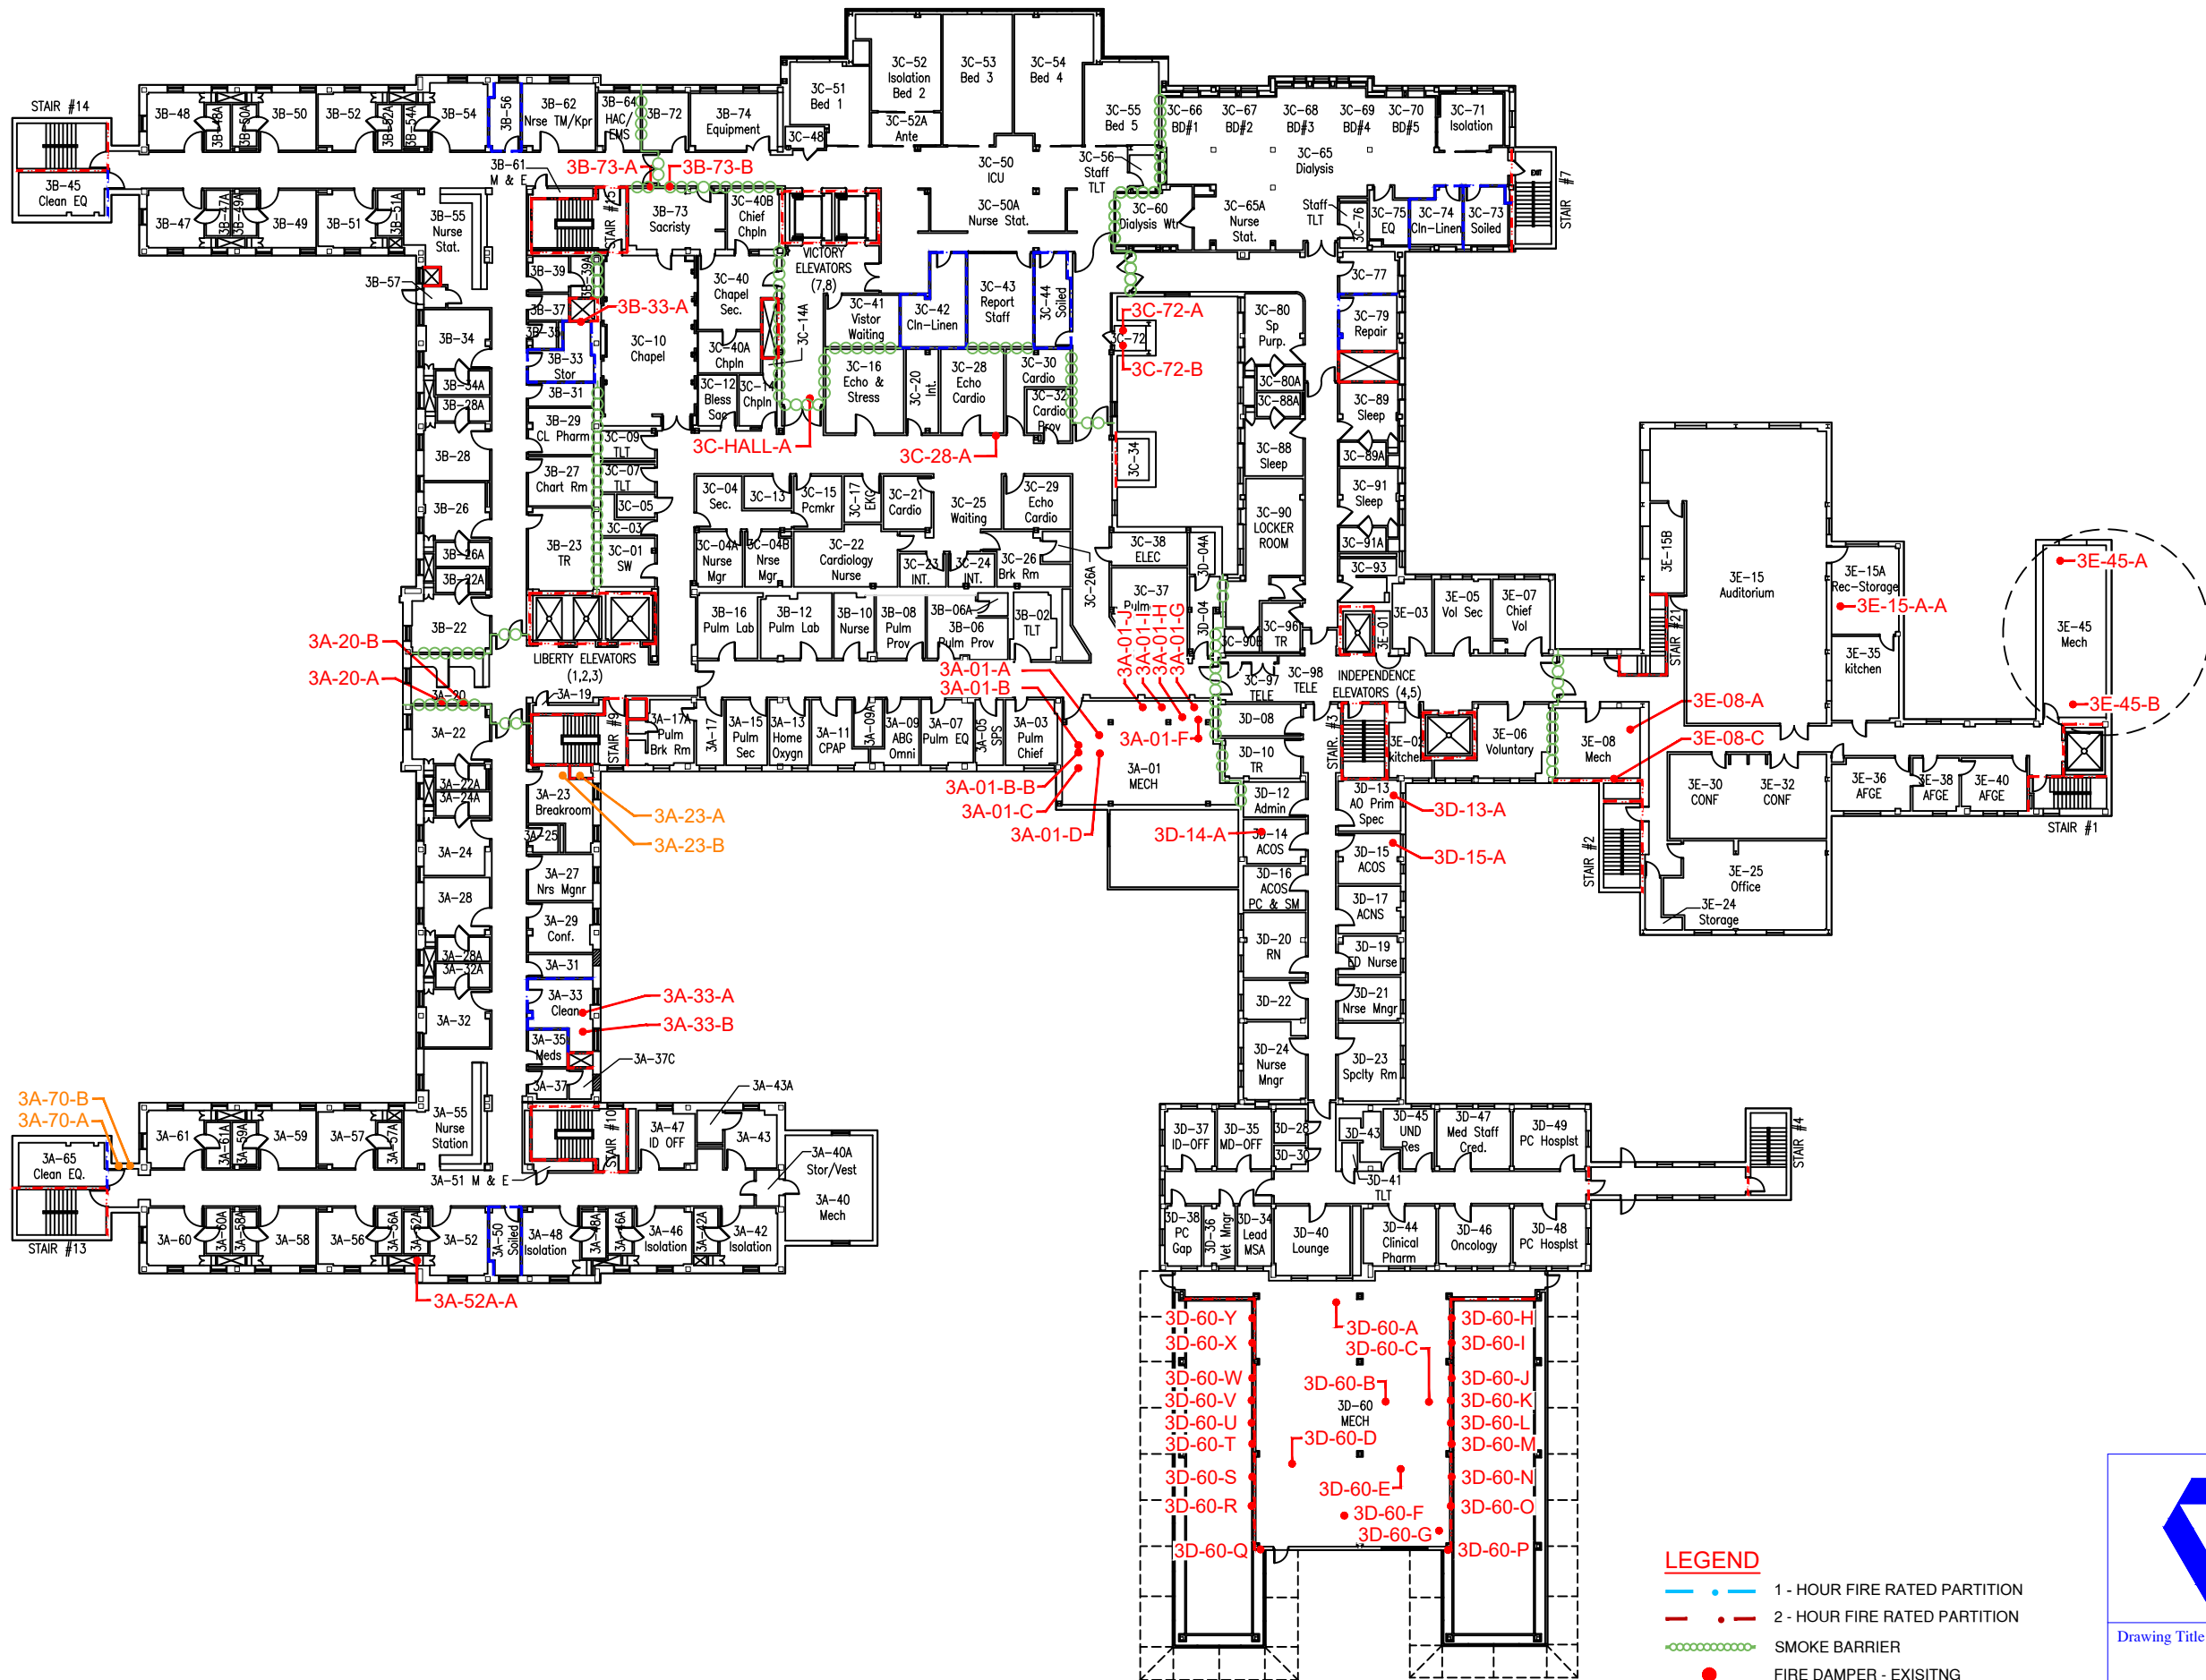

need to add info to spreadsheet





- LEGEND**
- 1 - HOUR FIRE RATED PARTITION
 - 2 - HOUR FIRE RATED PARTITION
 - o-o- SMOKE BARRIER
 - FIRE DAMPER - EXISTING
 - FIRE DAMPER - DISABLED
 - FIRE DAMPER - OUT OF SERVICE SYSTEM

FARGO VAHCS
 2101 ELM STREET
 FARGO, ND 58102

Drawing Title

Third Floor
FIRE DAMPER
 8/22/2024


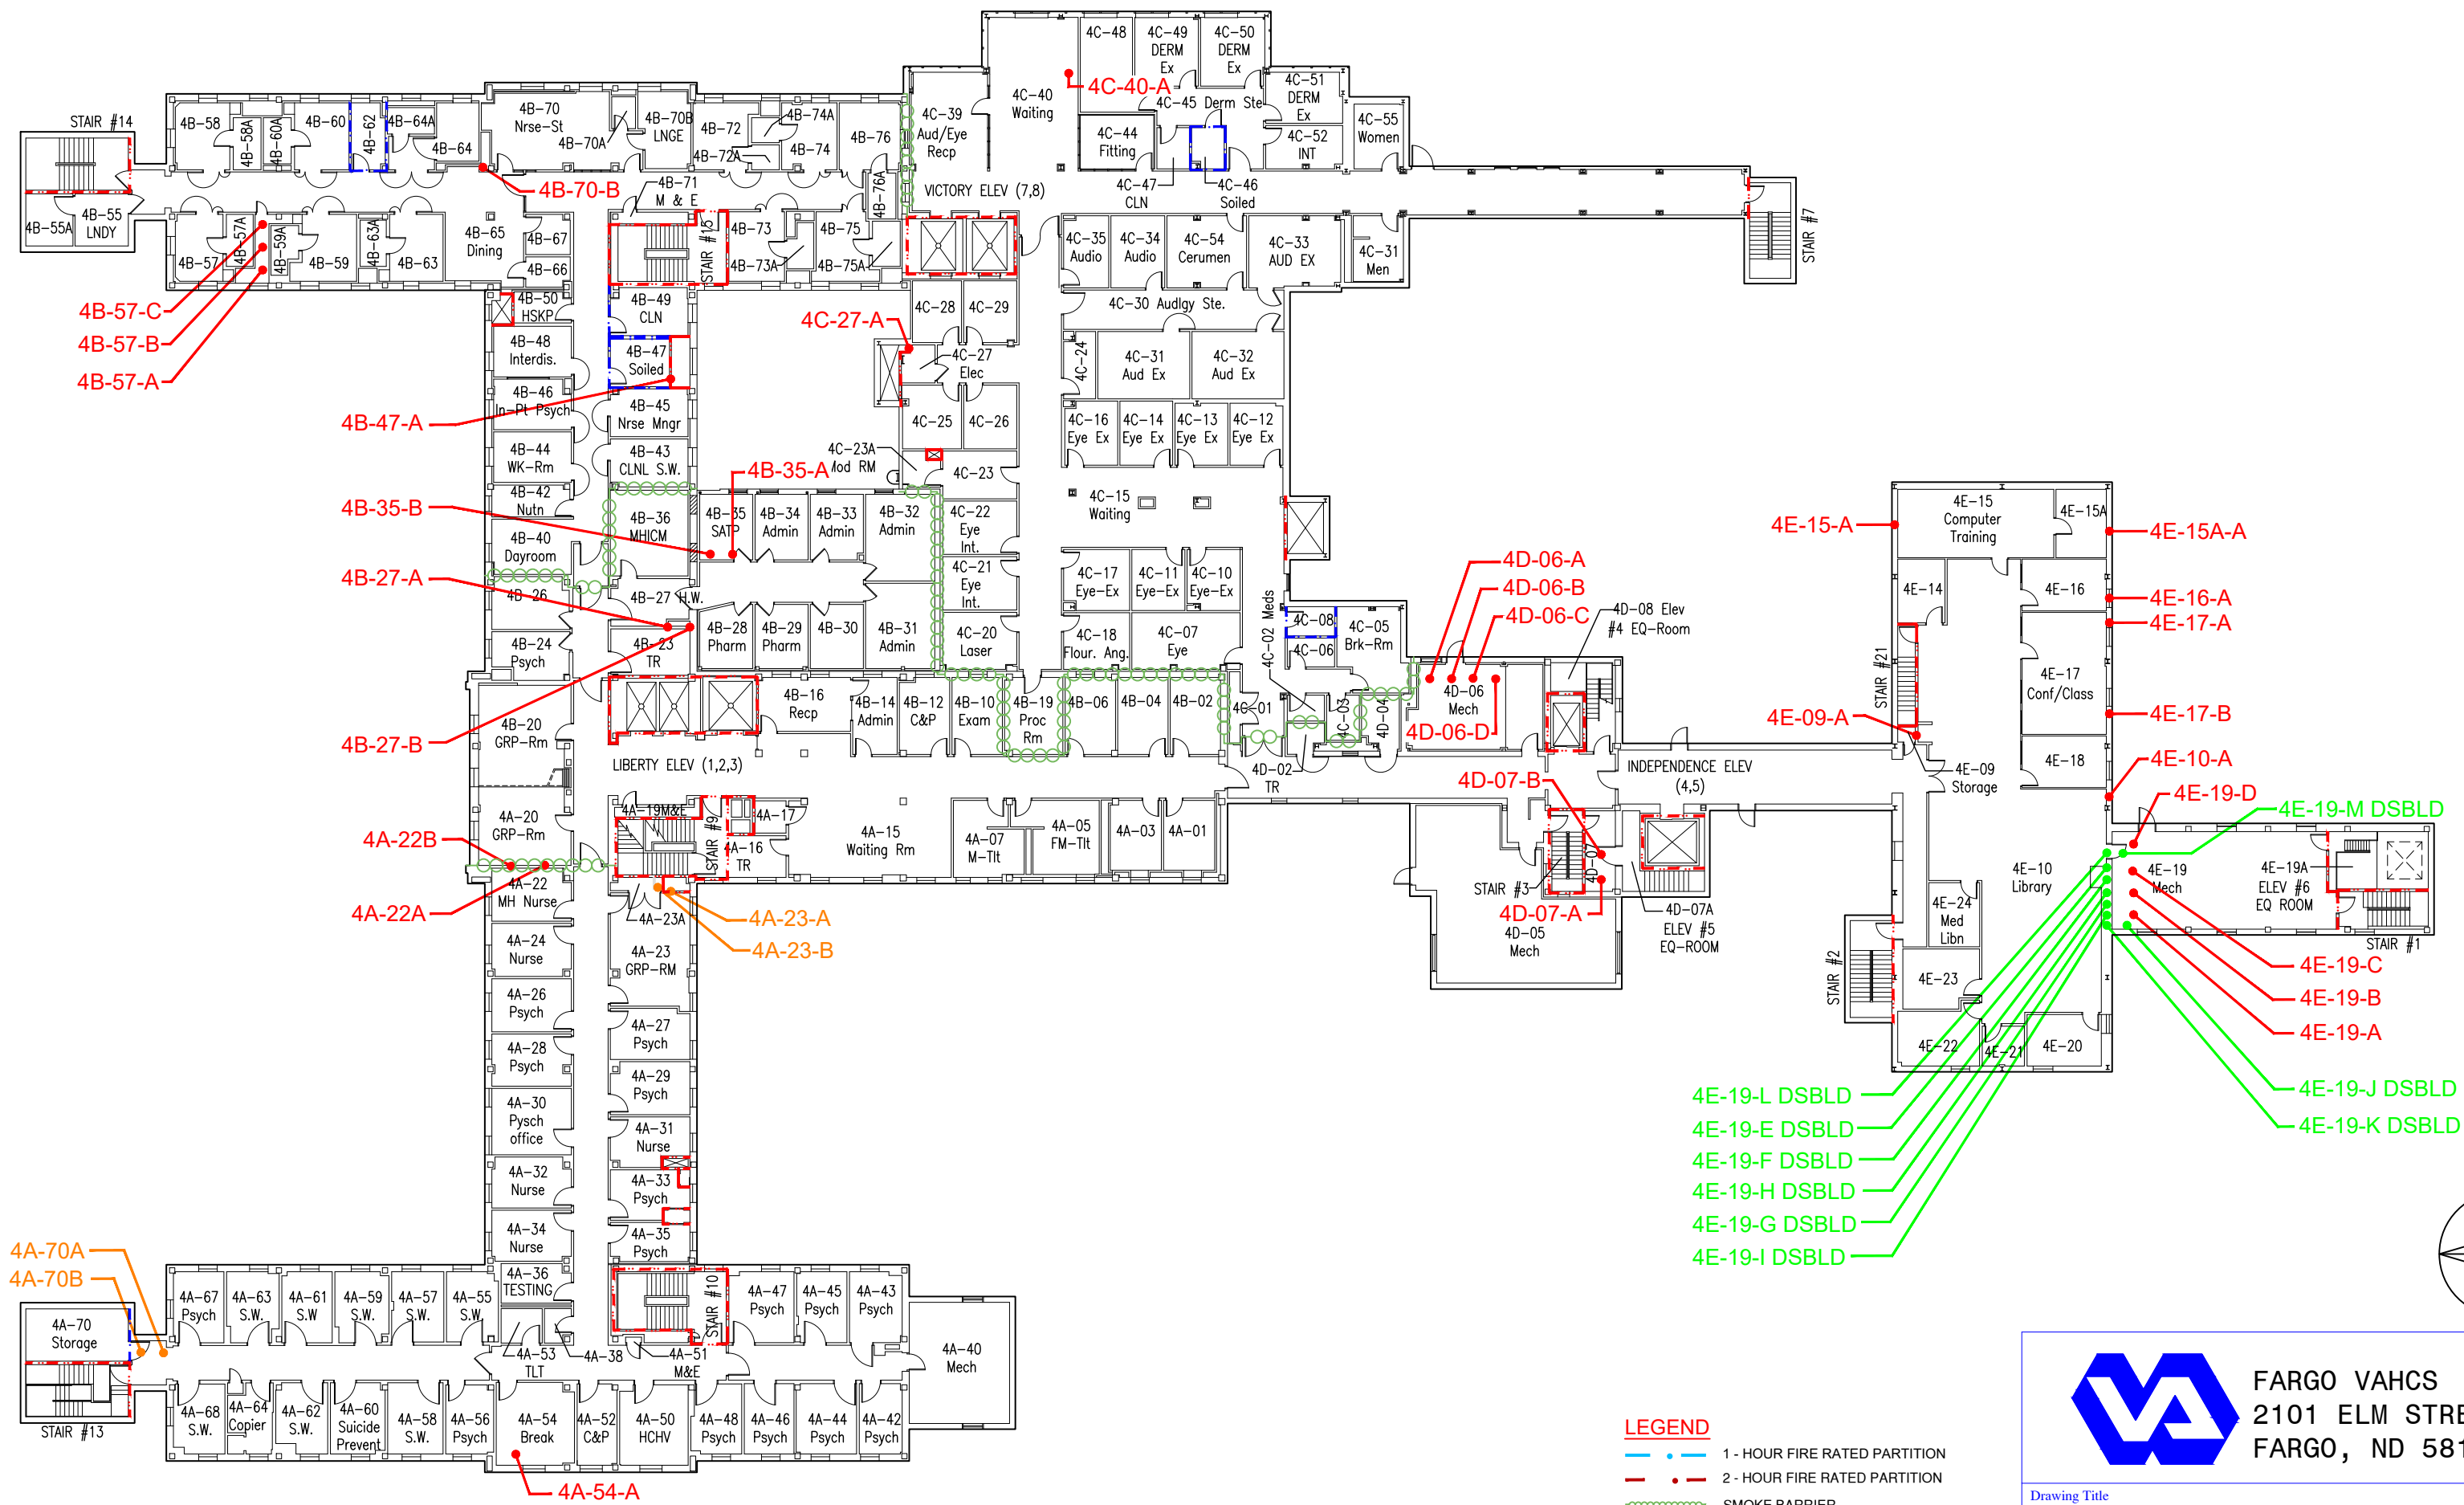


- LEGEND**
- 1 - HOUR FIRE RATED PARTITION
 - 2 - HOUR FIRE RATED PARTITION
 - o-o- SMOKE BARRIER
 - FIRE DAMPER - EXISTING
 - FIRE DAMPER - DISABLED
 - FIRE DAMPER - OUT OF SERVICE SYSTEM

FARGO VAHCS
 2101 ELM STREET
 FARGO, ND 58102

Drawing Title

Fourth Floor
FIRE DAMPER
 8/22/2024

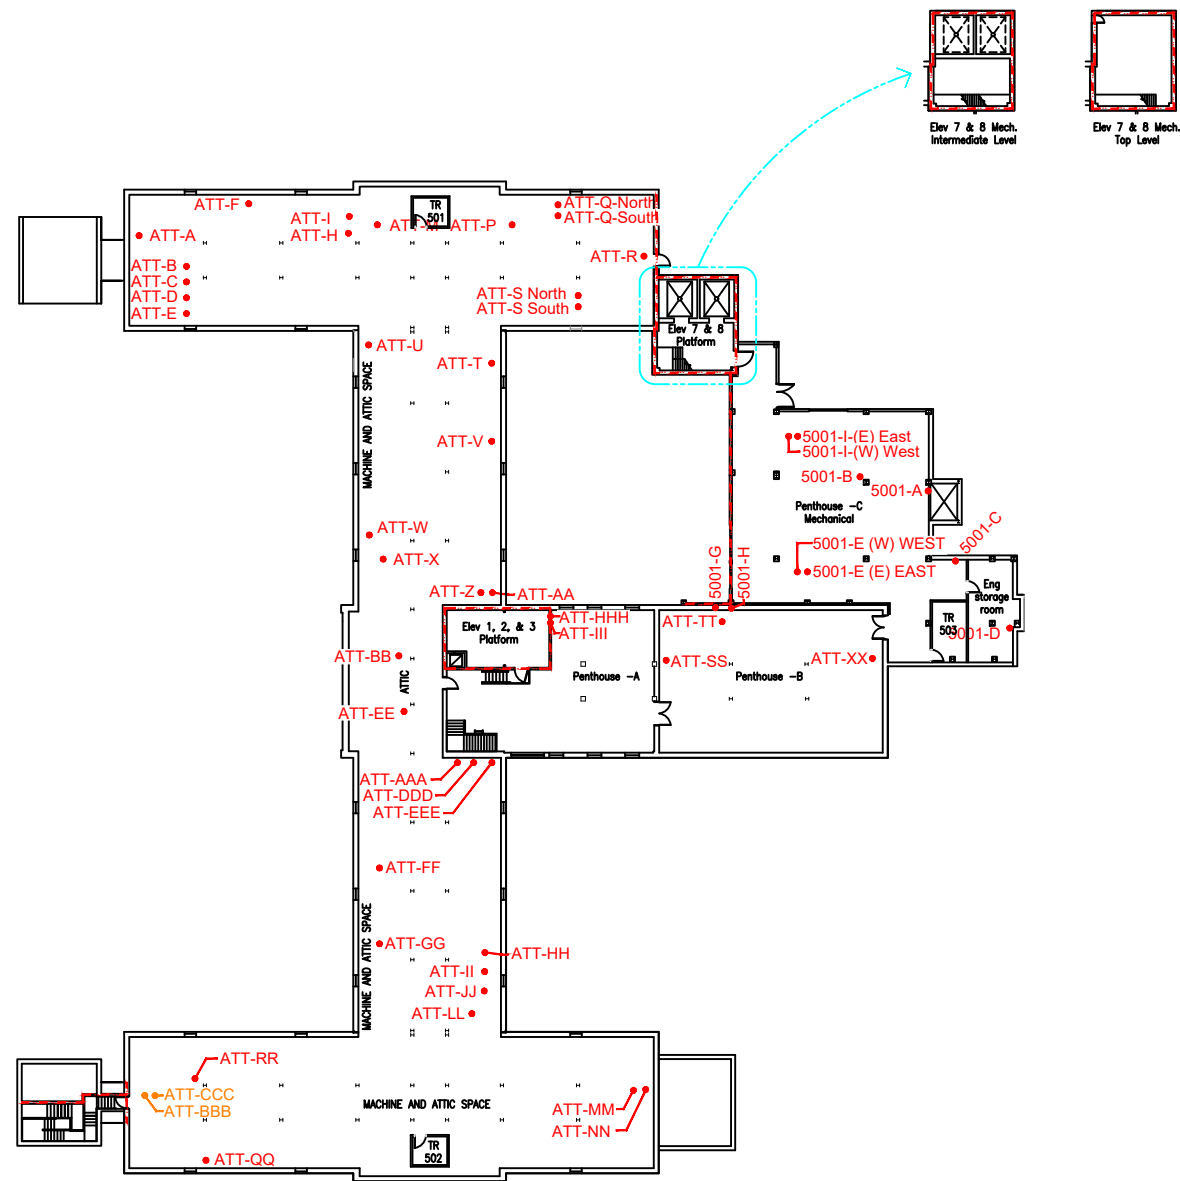

LEGEND

- 1 - HOUR FIRE RATED PARTITION
- 2 - HOUR FIRE RATED PARTITION
- - - - - SMOKE BARRIER
- FIRE DAMPER - EXISTING
- FIRE DAMPER - DISABLED
- FIRE DAMPER - OUT OF SERVICE SYSTEM



FARGO VAHCS
2101 ELM STREET
FARGO, ND 58102

Drawing Title

Attic/Penthouse
FIRE DAMPER
8/22/2024

LOCATION	TOTAL	NEW	Need Repair/Replace	Inaccessible	Disabled
BASEMENT	68	0	0	0	6
FIRST FLOOR	105	1	0	1	8
SECOND FLOOR	65	0	0	0	3
THIRD FLOOR	62	0	0	0	1
FOURTH FLOOR	45	0	0	1	9
ATTIC/PENTHOUSE	55	0	0	1	0
TOTALS	400	1	0	3	27

Fire Damper Tag ID Example: Red tag with white letters, (FD# 3D-13-A) (FD#)=Fire Damper Number, (3D)=First floor wing D, (13)=Room number, (A)=First damper in room

FD# 3D-13-A

Requirements

New Date of occupancy = Installation date
 Annual inspections Required within 6 years of previous inspection
 CLC Area CLC can be inspected in areas adjacent to the next 2hr fire rated wall.

Additional information

Next Inspection Cycle FY25 next required inspection dates based on 6 year requirement
 CLC previous inspection Last completed February 3rd & 4th 2021
 Corrective action contract FY20 (437-19-102) Corrections
 Previous Inspection Contract FY19 (437-19-102) previous inspection contract
 FY14-Corrective action report 437-14-125
 FY13-Previous Inspection Contract 437-13-122

Fire Damper #	Old Label	Date of Occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
BA-01-A		NA	NA	7/15/2019	Pass	7/15/2025		
BA-01-B		NA	NA	7/15/2019	Pass	7/15/2025		
BA-01-C		NA	NA	7/15/2019	Pass	7/15/2025		
BA-01-D		NA	NA	7/15/2019	Pass	7/15/2025		
BA-01-E		NA	NA	7/15/2019	Pass	7/15/2025		
BA-01-F		NA	NA	7/15/2019	Pass	7/15/2025		
BA-01-G		NA	NA	7/15/2019	Pass	7/15/2025		
BA-01-H		NA	NA	7/15/2019	Pass	7/15/2025		
BA-03-A		NA	NA	7/23/2019	Pass	7/23/2025		
BA-70-A	New							
BA-70-B	New							
BA-70-C	New							
BB-09-A		NA	NA	7/22/2019	Pass	7/22/2025		
BB-09-B		NA	NA	7/22/2019	Pass	7/22/2025		
BB-09-C		NA	NA	7/22/2019	Pass	7/22/2025		
BB-09-D		NA	NA	7/22/2019	Pass	7/22/2025		
BB-31-A	BB-31	NA	NA	7/23/2019	Pass	7/23/2025		
BB-70-A	BB-70A	NA	NA	6/27/2022	Pass	6/27/2028		
BB-80A-A		NA	NA	7/23/2019	Pass	7/23/2025		
BB-80A-B		NA	NA	7/23/2019	Pass	7/23/2025		
BB-82-A-DSBLD	BB-85-A-DSBLD	NA	NA	7/18/2022	Disabled	Disabled		Disabled 10/2/2002
BB-82-B-DSBLD	BB-85-B-DSBLD	NA	NA	7/18/2022	Disabled	Disabled		Disabled 10/2/2002
BB-96-A		NA	NA	1/16/2020	Pass	1/16/2026		
BC-15-A-DSBLD		NA	NA	7/18/2022	Disabled	Disabled		
BC-15-B_DSBLD				7/18/2022	Disabled	Disabled		
BC-20-A		NA	NA					
BC-20-B		NA	NA					
BC-20-C		NA	NA					
BC-20-D		NA	NA					
BC-20B-A	BB-05A-B	NA	NA	7/23/2019	Pass	7/23/2025		Access through hallway
BC-63-A		NA	NA					
BC-67-A-DSBLD		NA	NA	7/18/2022	Disabled	7/18/2028		Accessible through hall
BC-67-B-DSBLD		NA	NA	7/18/2022	Disabled	Disabled		Accessible through hall
BC-68-A	BC-68	NA	NA	7/23/2019	Pass	7/23/2025		
BC-85B-A	BC-85B	NA	NA	6/27/2022	Pass	6/27/2028		
BC-90-A		NA	NA	7/23/2019	Pass	7/23/2025		
BC-90-A-A		NA	NA	7/23/2019	Pass	7/23/2025		

Fire Damper #	Old Label	Date of Occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
BC-90-B		NA	NA	7/23/2019	Pass	7/23/2025		
BC-90-C		NA	NA	7/23/2019	Pass	7/23/2025		
BC-91-A		NA	NA	6/27/2022	Pass	6/27/2028		Inaccessible due to reach
BC-93-A		NA	NA	7/17/2019	Pass	7/17/2025		
BC-93-B		NA	NA	7/17/2019	Pass	7/17/2025		
BC-94-A		NA	NA	7/23/2019	Pass	7/23/2025		
BC-94-B		NA	NA	7/23/2019	Pass	7/23/2025		
BD-08-A	BD-08	NA	NA	7/23/2019	Pass	7/23/2025		
BD-08-B	BD-10-A	NA	NA	7/23/2019	Pass	7/23/2025		In room BD-08
BE-09-A		NA	NA	7/17/2019	Pass	7/17/2025		
BE-09-B		NA	NA	7/17/2019	Pass	7/17/2025		
BE-09-C		NA	NA	6/27/2022	Pass	6/27/2028		Inaccessible due to piping
BE-25-A	Exit A	NA	NA	7/17/2019	Pass	7/17/2025		
BE-25-B	Exit B	NA	NA	7/17/2001	Pass	7/18/2007		
BE-25-C	Exit C	NA	NA	7/17/2019	Pass	7/17/2025		
BE-29-A		NA	NA	7/16/2019	Pass	7/16/2025		
BE-29-B		NA	NA	7/16/2019	Pass	7/16/2025		
BE-29-C		NA	NA	7/16/2019	Pass	7/16/2025		
BE-29-D		NA	NA	7/16/2019	Pass	7/16/2025		
BE-29-E		NA	NA	7/16/2019	Pass	7/16/2025		
BE-29-F		NA	NA	7/16/2019		7/16/2025		
BE-29-G		NA	NA	7/16/2019	Pass	7/16/2025		
BE-29-H		NA	NA	7/16/2019	Pass	7/16/2025		
SUB-A		NA	NA	7/17/2019	Pass	7/17/2025		
SUB-B		NA	NA	8/16/2019	Pass	8/16/2025		Failed
SUB-C		NA	NA	7/17/2019	Pass	7/17/2025		
SUB-D		NA	NA	7/17/2019	Pass	7/17/2025		
SUB-E		NA	NA	7/17/2019	Pass	7/17/2025		
SUB-F		NA	NA	7/17/2019	Pass	7/17/2025		
SUB-G		NA	NA	7/17/2019	Pass	7/17/2025		
SUB-H		NA	NA	7/17/2019	Pass	7/17/2025		

Fire Damper #	Old Label	Date of Occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendation
1A-01-A		NA	NA	4/4/2022	Pass	4/4/2028		
1A-01-B		NA	NA	6/13/2019	Pass	6/13/2025		
1A-01-C		NA	NA	6/13/2019	Pass	6/13/2025		
1A-01-D		NA	NA	6/13/2019	Pass	6/13/2025		
1A-01-E		NA	NA	6/13/2019	Pass	6/13/2025		
1A-01-F		NA	NA	6/13/2019	Pass	6/13/2025		
1A-01-G		NA	NA	6/13/2019	Pass	6/13/2025		
1A-01-H		NA	NA	3/30/2022	Pass	3/30/2028		Spring is wrecked: will not close
1A-01-I-DSBLD		NA	NA	2/1/2022	Disabled	Disabled		
1A-01-J-DSBLD		NA	NA	2/1/2022	Disabled	Disabled		
1A-01-K-DSBLD	1106A	NA	NA	3/30/2022	Disabled	3/30/2028		
1A-05-A-A		NA	NA	6/30/2022	Pass	6/30/2028		
1A-20-A	C-101-A	NA	NA	3/30/2022	Pass	3/30/2028		
1A-20-B	C-101-B	NA	NA	3/30/2022	Pass	3/30/2028		
1A-58-A		NA	NA	7/6/2022	Closed	7/6/2028		
1A-58-B		NA	NA	6/26/2019	Pass	6/26/2025		
1A-60-A		NA	NA	12/17/2019	Pass	12/17/2025		
1A-60-B		NA	NA	12/17/2019	Pass	12/17/2025		
1A-60-C		NA	NA	12/17/2019	Pass	12/17/2025		
1A-60-D		NA	NA	12/17/2019	Pass	12/17/2025		
1A-66-A		NA	NA	7/24/2019	Pass	7/24/2025		
1A-66-B		NA	NA	7/24/2019	Pass	7/24/2025		
1B-103A	1B-102							
1B-115-A	CB-107	NA	NA	1/15/2020	Pass	1/15/2026		
1B-115-B		NA	NA	6/30/2022	Pass	6/30/2028		
1B-116-A	1B-116	NA	NA	1/15/2020	Pass	1/15/2026		
1B-116-B		NA	NA	6/30/2022	Pass	6/30/2028		
1B-120		NA	NA	1/15/2020	Pass	1/15/2026		
1B-128B-A		NA	NA	1/16/2020	Pass	1/16/2026		
1B-128B-B		NA	NA	1/16/2020	Pass	1/16/2026		
1B-128B-C		NA	NA	1/16/2020	Pass	1/16/2026		
1B-24-A	1B-47-A	NA	NA	7/16/2019	Pass	7/16/2025		
1B-24-B-DSBLD	1B-47-B	NA	NA	7/18/2022	Disabled	Disabled		
1B-24-C-DSBLD	1B-47-C	NA	NA	7/18/2022	Disabled	Disabled		
1B-26-A DSBLD		NA	NA	7/18/2022	Disabled	Disabled		
1B-35-A		NA	NA	6/24/2019	Pass	6/24/2025		
1B-35A-A		NA	NA	6/24/2019	Pass	6/24/2025		
1B-37-A		NA	NA	6/24/2019	Pass	6/24/2025		
1B-37A-A		NA	NA	6/24/2019	Pass	6/24/2025		

Fire Damper #	Old Label	Date of Occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendation
1B-37-B		NA	NA	6/24/2019	Pass	6/24/2025		
1B-37-C		NA	NA	6/24/2019	Pass	6/24/2025		
1B-38-A		NA	NA	6/24/2019	Pass	6/24/2025		
1B-60-A		NA	NA	7/15/2019	Pass	7/15/2025		
1B-60-B		NA	NA	7/16/2019	Pass	7/16/2025		
1B-60-C		NA	NA	7/15/2019		7/15/2025		Not fire damper
1B-60-D		NA	NA	7/15/2019	Pass	7/15/2025		
1B-71-A		NA	NA	6/30/2022	Pass	6/30/2028		
1B-74-B		NA	NA	6/30/2022	Inaccessible	6/30/2028		
1B-78-A		NA	NA	6/30/2022	Pass	6/30/2028		
1B-78-B		NA	NA	7/16/2019	Pass	7/16/2025		
1B-78-C		NA	NA	6/26/2019	Pass	6/26/2025		
1B-80-A		NA	NA	6/30/2022	Pass	6/30/2028		Currently Disconnected
1B-99_A		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-B		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-C		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-D		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-E		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-F		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-G		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-H		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-I		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1B-99-J		12/19/2019	3/3/2021	3/3/2021	Pass	3/4/2027		
1C-116-A	1C-110-A	NA	NA	7/9/2019	Pass	7/9/2025		
1C-116-B	1C-110-B	NA	NA	6/19/2019	Pass	6/19/2025		
1C-116-C	1C-110-C	NA	NA	6/19/2019	Pass	6/19/2025		
1C-125-A	1C-125	NA	NA	7/9/2019	Pass	7/9/2025		
1C-20-A		NA	NA	6/19/2019	Pass	6/19/2025		
1C-20-B		NA	NA	6/19/2019	Pass	6/19/2025		
1C-20-C		NA	NA	6/19/2019	Pass	6/19/2025		
1C-23-A	1C-23	NA	NA	6/19/2019	Pass	6/19/2025		
1C-83-A	1C-70A-A	NA	NA	6/18/2019	Pass	6/18/2025		
1C-83-B	1C-70A-B	NA	NA	6/18/2019	Pass	6/18/2025		
1C-83-C	1C-82	NA	NA	6/18/2019	Pass	6/18/2025		
1C-86-A-DSBLD		NA	NA		Disabled			
1C-86-B-DSBLD		NA	NA		Disabled			
1C-89-A	1C-89	NA	NA	6/20/2019	Pass	6/20/2025		

Fire Damper #	Old Label	Date of Occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendation
1C-99-A		NA	NA	6/30/2022	Pass	6/30/2028		
1D-01-A		NA	NA	3/4/2020	Pass	3/5/2026		
1D-101-A		NA	NA	7/16/2019	Pass	7/16/2025		
1D-101-B		NA	NA	7/16/2019	Pass	7/16/2025		
1D-141-A	1D-141-E	NA	NA	6/19/2019	Pass	6/19/2025		We believe we found 2 extras not accounted
1D-141-B		NA	NA					
1D-148-A	New	New	New	New	New	#VALUE!		
1D-15-A		NA	NA	7/16/2019	Pass	7/16/2025		
1D-15-B		NA	NA	7/16/2019	Pass	7/16/2025		
1D-16-A		NA	NA	3/30/2022	Pass	3/30/2028		
1D-16-B		NA	NA	3/30/2022	Pass	3/30/2028		
1D-57-A		NA	NA	7/16/2019	Pass	6/19/2025		
1D-59-A		NA	NA	6/30/2022	Pass	6/30/2028		
1D-59-B		NA	NA	6/30/2022	Pass	6/30/2028		
1D-59-C	1D-141-C	NA	NA	6/19/2019	Pass	6/19/2025		
1D-59-D	1D-141-B	NA	NA	6/19/2022	Pass	6/19/2028		
1D-60-A	1D-141-A	NA	NA	6/19/2019	Pass	6/19/2025		
1D-72-A		NA	NA	4/1/2022	Pass	4/1/2028		
1D-73-A		NA	NA	7/16/2019	Pass	7/16/2025		
1D-73-B		NA	NA	6/19/2019	Pass	6/19/2025		
1D-73-C		NA	NA	6/19/2019	Pass	6/19/2025		
1D-75-A		NA	NA	7/16/2019	Pass	7/16/2025		
1D-75-B		NA	NA	7/16/2019	Pass	7/16/2025		
1D-80-A		NA	NA	7/16/2019	Pass	7/16/2025		
1D-84-A	1D-141-H	NA	NA	6/30/2022	Pass	6/30/2028		
1D-85-A	1D-141-G	NA	NA	6/19/2019	Pass	6/19/2025		
1D-85-B	1D-141-F	NA	NA	6/30/2022	Pass	6/30/2028		
1D-95-A		NA	NA	6/19/2019	Pass	6/19/2025		
1D-99-A								

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of fire damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
2A-01-A		NA	NA	5/6/19	Pass	5/6/25		
2A-01-B-DSBLD		NA	NA	7/18/22	Disabled	7/18/28		
2A-01-C-Hall	2A-01-Hall	NA	NA	2/17/21	Pass	2/18/27		
2A-01-I		NA	NA	5/13/19	Pass	5/13/25		
2A-01-J		7/8/13	8/9/14	5/13/19	Pass	5/13/25		
2A-01-K		NA	NA	5/13/19	Pass	5/13/25		
2A-01-L		NA	NA	7/30/19	Pass	7/30/25		Replacement recommended: Worn, won't close all the way
2A-01-M		NA	NA	5/13/19	Pass	5/13/25		
2A-20-A		NA	NA	7/15/22	Pass	7/15/28		
2A-20-B		NA	NA	7/15/22	Pass	7/15/28		
2A-29-A	2101A-A	NA	NA	5/15/19	Pass	5/15/25		
2A-65-A	2A-65A	8/15/07	7/9/13	6/28/22		6/28/28		
2B-13-A-DSBLD		NA	NA	7/18/22	Disabled	7/18/28		
2B-13-B-DSBLD		NA	NA	7/18/22	Disabled	7/18/28		
2B-32-B		NA	NA	6/29/22	Pass			
2B-34-A	2B-34	NA	NA	12/17/19	Pass	12/17/25		
2B-36-A								
2B-54-A		NA	NA	6/30/22	Pass	6/30/28		
2B-90-A		NA	NA	5/14/19	Pass	5/14/25		
2B-90-B		NA	NA	5/14/19	Pass	5/14/25		
2B-90-C		NA	NA	5/14/19	Pass	5/14/25		
2B-90-D			NA	6/29/22	Pass	6/29/28		
2B-95-A	2B-95-B	NA	NA	5/14/19	Pass	5/14/25		Labeled as two dampers but there is only one
2B-95-C		NA	NA	6/29/22	Pass			Not able to Access
2C-15-A	2C-22	NA	NA	7/30/19	Pass	7/30/25		
2C-36-A	2C-36	NA	NA	7/23/19	Pass	7/23/25		
2C-75-A	2C-75	NA	NA	5/14/19	Pass	5/14/25		
2D-100-A		NA	NA	7/24/19	Pass	7/24/25		
2D-100-B	2D-102-A	NA	NA	2/17/21	Pass	2/17/27		
2D-12-A		NA	NA	5/13/19	Pass	5/13/25		
2D-12-B		NA	NA	5/13/19	Pass	5/13/25		
2D-12-C		NA	NA	5/13/19	Pass	5/13/25		
2D-18-A		NA	NA	2/17/21	Pass	2/17/27		Access difficult
2D-19-A	2D-20-A	NA	NA	5/16/19	Pass	5/16/25		
2D-20-B		NA	NA	5/21/19	Pass	5/21/25		
2D-20-C		NA	NA	5/21/19	Pass	5/21/25		
2D-21A		NA	NA	6/13/19	Pass	6/13/25		
2D-39-A		NA	NA	6/12/19	Pass	6/12/25		
2D-41-A		NA	NA	6/12/19	Pass	6/12/25		
2D-44-A		NA	NA	7/24/19	Pass	7/24/25		

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of fire damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
2D-44-B		NA	NA	7/24/19	Pass	7/24/25		
2D-44-C		NA	NA	2/17/21	Pass	2/17/27		
2D-45-A		NA	NA	2/17/21	Pass	2/17/27		
2D-48-A		NA	NA	6/13/19	Pass	6/13/25		
2D-78A-A								
2D-48-B		NA	NA	6/13/19	Pass	6/13/25		
2D-84-A		NA	NA	6/12/19	Pass	6/12/25		
2D-86-B		NA	NA	6/13/19	Pass	6/13/25		
2D-86-C		NA	NA	6/12/19	Pass	6/12/25		
2D-86-E		NA	NA	6/12/19	Pass	6/12/25		
2D-88-A		NA	NA	6/12/19	Pass	6/12/25		
2D-91-A		NA	NA	2/2/22	Pass	2/2/28		Add second access door. Hard to reach add door to bottom of duct.
2D-91-B		NA	NA	2/2/22	Pass	2/2/28		
2D-91-C		NA	NA	2/2/22	Pass	2/2/28		
2D-91-D		NA	NA	2/2/22	Pass	2/2/28		
2D-95A-A	2D-90-A	NA	NA	6/13/19	Pass	6/13/25		
2D-96-A	2D-96	NA	NA	10/30/19	Pass	10/30/25		
2D-98-A		NA	NA	5/21/19	Pass	5/21/25		
2D-98-B		NA	NA	2/2/22	Pass	2/2/28		
2E-16-A		NA	NA	7/23/19	Pass	7/23/25		
2E-16-B		NA	NA	7/23/19	Pass	7/23/25		
C202-A		NA	8/15/07	12/17/19	Pass	12/17/25		
C202-D		NA	8/15/07	12/17/19	Pass	12/17/25		
C202-F		NA	8/15/07	12/17/19	Pass	12/17/25		

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
3A-01-A		NA	NA	5/1/2019	Pass	5/1/2025		
3A-01-B		NA	NA	5/1/2019	Pass	5/1/2025		
3A-01-B-B-DSBLD		NA	NA	5/1/2019	Disabled	5/1/2025		
3A-01-C		NA	NA	5/2/2019	Pass	5/2/2025		Not right type damper cant close, replace
3A-01-D		7/16/2013	8/20/2014	5/1/2019	Pass	5/1/2025		
3A-01-F		7/10/2013	8/18/2014	5/1/2019	Pass	5/1/2025		
3A-01-G		7/10/2013	9/3/2014	5/1/2019	Pass	5/1/2025		
3A-01-H		7/10/2013	8/27/2014	5/1/2019	Pass	5/1/2025		
3A-01-I		NA	NA	5/1/2019	Pass	5/1/2025		
3A-01-J		7/10/2013	8/21/2014	5/1/2019	Pass	5/1/2025		
3A-20-A	3A-22-A	NA	NA	5/1/2019	Pass	5/1/2025		
3A-20-B	3A-22-B	NA	NA	5/1/2019	Pass	5/1/2025		
3A-23-A		NA	NA	3/7/2022	Pass	3/7/2028		
3A-23-B		NA	NA	3/7/2022	Pass	3/7/2028		
3A-33-A		NA	NA	5/1/2019	Pass	5/1/2025		
3A-33-B		NA	NA	5/1/2019	Pass	5/1/2025		
3A-52-A-A	New							
3A-70-A		NA	NA	12/17/2019	Pass	12/17/2025		
3A-70-B		NA	NA	12/17/2019	Pass	12/17/2025		
3B-23-A		NA	NA	3/7/2022	Pass	3/7/2028		
3B-23-B		NA	NA	3/7/2022	Pass	3/7/2028		
3B-33-A	3B-37-A	NA	NA	5/1/2019	Pass	5/1/2025		
3B-73-A	3B-73-C	NA	NA	5/2/2019	Pass	5/2/2025		
3B-73-B		NA	NA	5/2/2019	Pass	5/2/2025		
3C-28-A		NA	NA	3/7/2022	Pass	3/7/2028		
3C-72-A		NA	NA	6/28/2022	Pass	6/28/2028		
3C-72-B		NA	NA	6/28/2022	Pass	6/28/2028		
3C-HALL-A		NA	8/16/2007	5/2/2019	Pass	5/2/2025		
3D-13-A		NA	8/16/2007	5/2/2019	Pass	5/2/2025		
3D-14-A	3D-14	NA	8/16/2007	2/2/2022	Pass	2/3/2028		2 Outlets
3D-15-A	3D-15	NA	NA	6/29/2022	Pass	6/29/2028		
3D-60-A		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-B		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-C		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-D		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-E		NA	NA	4/8/2019	Pass	4/8/2025		4 Outlets
3D-60-F		NA	NA	4/8/2019	Pass	4/8/2025		8 Outlets
3D-60-G		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-H		NA	NA	4/4/2019	Pass	4/4/2025		
3D-60-I		NA	NA	4/4/2019	Pass	4/4/2025		

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
3D-60-J		NA	NA	4/4/2019	Pass	4/4/2025		
3D-60-K		NA	NA	4/4/2019	Pass	4/4/2025		
3D-60-L		NA	NA	4/4/2019	Pass	4/4/2025		
3D-60-M		NA	NA	4/4/2019	Pass	4/4/2025		
3D-60-N		NA	NA	4/4/2019	Pass	4/4/2025		
3D-60-O		NA	NA	4/4/2019	Pass	4/4/2025		
3D-60-P		NA	NA	4/4/2019	Pass	4/4/2025		2 Outlets
3D-60-Q		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-R		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-S		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-T		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-U		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-V		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-W		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-X		NA	NA	4/8/2019	Pass	4/8/2025		
3D-60-Y		NA	NA	4/8/2019	Pass	4/8/2025		
3E-08-A		NA	NA	4/9/2019	Pass	4/9/2025		
3E-08-C		NA	NA	4/9/2019	Pass	4/9/2025		
3E-15-A-A		NA	NA					
3E-45-A		NA	NA					
3#-45-B		NA	NA					

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of fire damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
4A-22-A		NA	NA	4/26/2019	Pass	4/26/2025		
4A-22-B		NA	NA	4/26/2019	Pass	4/26/2025		
4A-23-A		NA	NA	7/15/2022	Pass	7/15/2028		
4A-23-B		NA	NA	7/15/2022	Inaccessible	7/15/2028		
4A-54-A	New							
4A-70A		NA	NA	12/17/2019	Pass	12/17/2025		
4A-70B		NA	NA	12/17/2019	Pass	12/17/2025		
4B-27-A		NA	8/22/2007	4/22/2019	Pass	4/22/2025		
4B-27-B		NA	8/22/2007	4/22/2019	Pass	4/22/2025		
4B-35-A		NA	8/22/2007	4/22/2019	Pass	4/22/2025		
4B-35-B		NA	8/22/2007	4/22/2019	Pass	4/22/2025		
4B-47-A		NA	8/22/2007	4/22/2019	Pass	4/22/2025		
4B-57-A		NA	NA	4/29/2019	Pass	4/29/2025		
4B-57-B		NA	NA	4/29/2019	Pass	4/29/2025		
4B-57-C		NA	NA	4/29/2019	Pass	4/29/2025		
4B-70-B		NA	8/22/2007	4/29/2019	Pass	4/29/2025		
4C-27-A		NA	8/20/2007	4/22/2019	Pass	4/22/2025		
4C-40-A	New							
4D-06-A		NA	NA	4/4/2019	Pass	4/4/2025		
4D-06-B		NA	NA	4/4/2019	Pass	4/4/2025		
4D-06-C		NA	NA	4/4/2019	Pass	4/4/2025		
4D-06-D		NA	NA	4/4/2019	Pass	4/4/2025		
4D-07-A		NA	NA	7/23/2019	Pass	7/23/2025		
4D-07-B		NA	NA	4/4/2019	Pass	4/4/2025		
4E-09-A		NA	NA	3/10/2022	Pass	3/10/2028		
4E-10-A		NA	NA	3/7/2022	Pass	3/7/2028		
4E-15-A		NA	NA	3/7/2022	Pass	3/7/2028		
4E-15-A-A		NA	NA	3/7/2022	Pass	3/7/2028		
4E-16-A		NA	NA	3/7/2022	Pass	3/7/2028		
4E-17-A		NA	NA	3/7/2022	Pass	3/7/2028		
4E-17-B		NA	NA	3/7/2022	Pass	3/7/2028		
4E-19-A		NA	NA	4/29/2019	Pass	4/29/2025		
4E-19-B		NA	NA	4/29/2019	Pass	4/29/2025		
4E-19-C		NA	NA	4/29/2019	Pass	4/29/2025		
4E-19-D		NA	NA	4/29/2019	Pass	4/29/2025		
4E-19-E-DSBLD		NA	NA	7/18/2022	Disabled	2/9/1906		
4E-19-F-DSBLD		NA	NA	7/18/2022	Disabled	2/10/1906		
4E-19-G-DSBLD		NA	NA	7/18/2022	Disabled	2/11/1906		

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of fire damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
4E-19-H-DSBLD		NA	NA	7/18/2022	Disabled	2/12/1906		
4E-19-I-DSBLD		NA	NA	7/18/2022	Disabled	2/13/1906		
4E-19-J-DSBLD		NA	NA	7/18/2022	Disabled	2/14/1906		
4E-19-K-DSBLD		NA	NA	7/18/2022	Disabled	2/15/1906		
4E-19-L-DSBLD		NA	NA	7/18/2022	Disabled	2/16/1906		
4E-19-M-DSBLD		NA	NA	7/18/2022	Disabled	2/17/1906		

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
5001-A		NA	NA	7/23/2019	Pass	7/23/2025		
5001-B		NA	NA	5/2/2019	Pass	5/2/2025		
5001-C		NA	NA	5/2/2019	Pass	5/2/2025		
5001-D		NA	NA	4/29/2019	Pass	4/29/2025		
5001-E East		NA	NA	7/23/2019	Pass	7/23/2025		
5001-E West		NA	NA	7/23/2019	Pass	7/23/2025		
5001-G		NA	NA	4/29/2019	Pass	4/29/2025		
5001-H		NA	NA	4/29/2019	Pass	4/29/2025		
5001-I-East		NA	NA	7/23/2019	Pass	7/23/2025		
5001-I-West		NA	NA	7/23/2019	Pass	7/23/2025		
ATT-A		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-AA		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-AAA		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-B		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-BB		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-BBB		NA	NA	4/3/2019	Inaccessible	4/3/2025		Locked could not open
ATT-C		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-CCC		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-D		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-DDD		NA	NA	7/23/2019	Pass	7/23/2025		
ATT-E		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-EE		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-EEE		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-F		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-FF		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-GG		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-H		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-HH		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-HHH		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-I		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-II		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-III		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-JJ		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-LL		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-M		NA	NA	4/25/2019	Pass	4/25/2025		
ATT-MM		NA	NA	12/17/2019	Pass	12/17/2025		
ATT-NN		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-P		NA	NA	4/4/2019	Pass	4/4/2025		
ATT-Q-North		NA	NA	7/22/2019	Pass	7/22/2025		
ATT-QQ		NA	NA	7/23/2019	Pass	7/23/2025		
ATT-Q-South		NA	NA	7/23/2019	Pass	7/23/2025		
ATT-R		NA	NA	7/23/2019	Pass	7/23/2025		
ATT-RR		NA	NA	4/25/2019	Pass	4/25/2025		

Fire Damper #	Old Label	Date of occupancy	Date of initial inspection	Date of previous inspection	Current Condition of Fire Damper	Date of next inspection	Label Needed	Inspection Notes/Recommendations
ATT-S North		NA	NA	7/23/2019	Pass	7/23/2025		
ATT-S South		NA	NA	7/23/2019	Pass	7/23/2025		
ATT-SS		NA	NA	4/29/2019	Pass	4/29/2025		
ATT-T		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-TT		NA	NA	4/29/2019	Pass	4/29/2025		
ATT-U		NA	NA	4/5/2022	Pass	4/5/2028		
ATT-V		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-W		NA	NA	4/3/2019	Pass	4/3/2025		
ATT-X		NA	NA	5/2/2019	Pass	5/2/2025		
ATT-XX		NA	NA	4/29/2019	Pass	4/29/2025		
ATT-Z		NA	NA	5/2/2019	Pass	5/2/2025		